


PROFILE VIEW

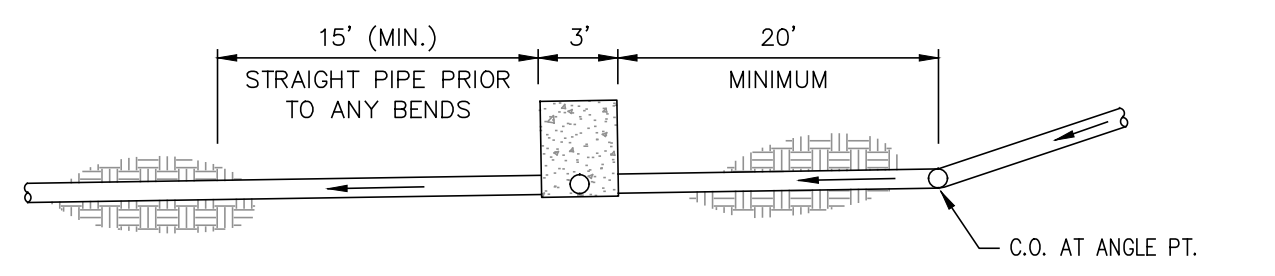

PLAN VIEW

NOTE:

1. BARREL DIAMETER OF SAMPLING WYE SHALL BE A MINIMUM OF 2" LARGER THAN BLDG. DISCHARGE LINE.
2. DIAMETER OF RISER PIPE SHALL BE 4".
3. THE LOCATION OF THE SAMPLING WYE MUST BE ACCESSIBLE AT ALL TIMES TO DISTRICT PERSONNEL.
4. THE SAMPLING WYE SHALL NOT BE LOCATED IN TRAFFIC AREAS.
5. ALL MATERIALS UTILIZED SHALL CONFORM TO DISTRICT STANDARDS.

JURUPA COMMUNITY SERVICES DISTRICT

SCALE:	<b>BUILDING SEWER SAMPLER DETAIL</b>	DRAWING NO.
DATE: SEPTEMBER 2020		<b>S-14</b>
APPROVED BY: <i>Sinnaro Yos</i>	ALBERT A. WEBB ASSOCIATES CONSULTING ENGINEERS	
Sinnaro Yos, P.E. C68607	RIVERSIDE CALIFORNIA	W.O. 19-0248

REV.