


**PLAN VIEW**

N.T.S.

**NOTES:**

1. DOMESTIC SEWAGE CONNECTION IS TO BE MADE DOWNSTREAM OF GRAVITY SEPARATOR SAMPLE BOX.
2. PRECAST CONCRETE VAULT INCLUDING TOP AND COVERS TO BE DESIGNED FOR A MINIMUM H-20 TRAFFIC LOADING. SQUARE COVERS ARE NOT ACCEPTABLE.
3. ALL PIPE AND FITTINGS TO BE CAST IRON OR PVC PIPE.
4. THE REQUIRED CAPACITY FOR THE GRAVITY SEPARATOR SHALL BE BASED UPON APPENDIX H OF THE UNIFORM PLUMBING CODE.
5. WASTE DISCHARGE APPLICANT IS RESPONSIBLE FOR THE PURCHASE, INSTALLATION, OPERATION AND MAINTENANCE OF THE GRAVITY SEPARATOR.
6. APPROVED SUPPLIERS FOR GRAVITY SEPARATOR
  - a. PYRAMID PRECAST CO., INC. RIALTO, CA.
  - b. M.C. NOTTINGHAM CO., PASADENA, CA.
  - c. UTILITY VAULT CO., FONTANA, CA.
  - d. JENSEN PRECAST CO., FONTANA, CA.
7. LOCATION OF GRAVITY SEPARATOR IS SUBJECT TO APPROVAL BY DISTRICT.
8. PROVIDE LABEL INDICATING MANUFACTURE OF GRAVITY SEPARATOR AND CONFORMANCE TO U.P.C.
9. SAMPLE BOX IS REQUIRED.
10. GRADE RING JOINTS TO BE SEALED WITH 1:2 MORTAR, TRIMMED TO A SMOOTH FINISH INSIDE AND OUT.
11. THE MANHOLE FRAME IS TO BE SEALED WITH AND SECURED BY A MOTAR RING.

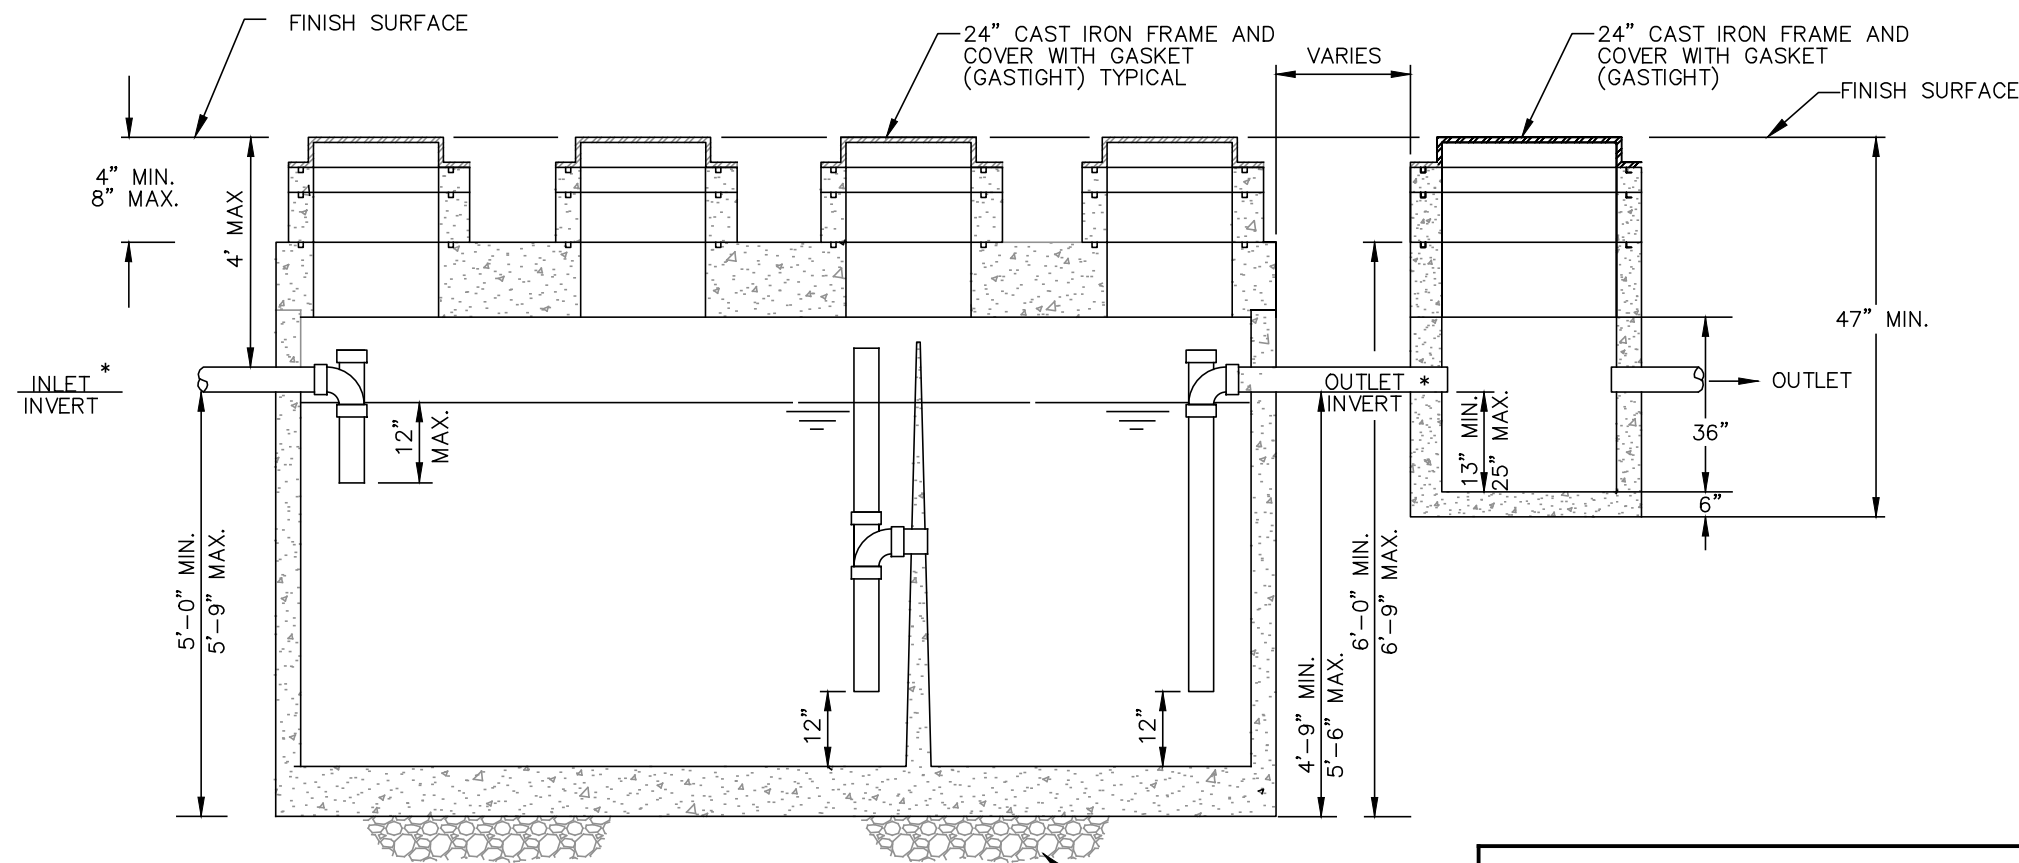

**SECTIONAL VIEW**

N.T.S.

\* INVERT ELEVATION SHALL BE AS SHALLOW AS POSSIBLE, NOT DEEPER THAN 4' FROM FINISH SURFACE ELEVATION.

**JURUPA COMMUNITY SERVICES DISTRICT**

SCALE:	<b>GREASE INTERCEPTOR 2000 GAL. TO 3000 GAL.</b>	DRAWING NO.
DATE: SEPTEMBER 2020		<b>S-20</b>
APPROVED BY: <i>Sinnaro Yos</i>	ALBERT A. WEBB ASSOCIATES CONSULTING ENGINEERS	
Sinnaro Yos, P.E. C68607	RIVERSIDE CALIFORNIA	W.O. 19-0248

REV.