

Element 3: LEGAL AUTHORITY

This element of the SSMP discusses the District's Legal Authority. This section fulfills the Legal Authority requirement for the SWRCB (Element 3) SSMP requirements.

3.1 Regulatory Requirements for Legal Authority Element

The requirements for the Legal Authority element of the SSMP are summarized below:

WDR Requirement

The District must demonstrate, through collection system use ordinances, service agreements, or other legally binding procedures, that it possesses the necessary legal authority to:

- (a) Prevent illicit discharges into its wastewater collection system (examples may include infiltration and inflow (I/I), storm water, chemical dumping, unauthorized debris and cut roots, etc.);
- (b) Require that sewers and connections be properly designed and constructed;
- (c) Ensure access for maintenance, inspection, or repairs for portions of the lateral owned or maintained by the Public Agency;
- (d) Limit the discharge of fats, oils, and grease and other debris that may cause blockages, and
- (e) Enforce any violation of its sewer ordinances.

3.2 Element 3 Attachments

Supporting information for Element 3 is included in Attachment E-3. The attachments include the table of contents of the following documents:

Attachment E3-A: JCSD Ordinance 5 - Sewer Use Ordinance
Attachment E3-B: JCSD Ordinance 35 – Update Prohibited Inflows and Sewer Construction
Attachment E3-C: JCSD Ordinance 78 – Sewer Lateral Responsibility
Attachment E3-D: JCSD Ordinance 226 – Riverside Area Industrial Waste Ordinance
Attachment E3-E: JCSD Ordinance 227 – Riverside Area Local Limit Ordinance
Attachment E3-F: JCSD Ordinance 412 – WRCRWA Area Industrial Waste Ordinance
Attachment E3-G: JCSD Ordinance 413 – FOG Ordinance (All Areas)
Attachment E3-H: JCSD Ordinance 423 – Brine Line Area Industrial Waste Ordinance
Attachment E3-I: JCSD Ordinance 424 – Brine Line Area Local Limit Ordinance
Attachment E3-J: JCSD Ordinance 425 – Riverside Area Local Limit Ordinance Amendment
Attachment E3-K: JCSD Ordinance 433 – Backwater Valve Ordinance
Attachment E3-L: JCSD Resolution 2399 – Brine Line Enforcement Response Plan
Attachment E3-M: JCSD Standards Manual
Attachment E3-N: Diagram illustrating lateral maintenance responsibilities

The above referenced documents can be fully accessed on the District's website at www.jcsd.us.

3.3 District Ordinances

The legal authority required for the SSMP by the SWRCB is contained within the District's Ordinances and Standards Manual. Several Ordinances are dedicated to the sewer system and are relevant to the legal authority requirements of the SSMP:

- Ordinance 5 Connections To District Sewer System. Provides the regulations for connections to the District's sewer system.
- Ordinance 35 Sewer System Construction. Provides the regulations for the construction, alteration or repair of District sewer facilities.
- Ordinance 78 Sewer Lateral Maintenance Responsibility. Establishes the customer as the responsible party for the maintenance and repair of sewer laterals.
- Ordinance 226 (Riverside), 412 (WRCRWA) and 423 (Brine Line) Sewer System Protection Regulations. Includes Industrial Waste regulations for JCSD's 3 service areas to protect human health, the environment and the sewer system.
- Ordinance 227 and 425 (Riverside), 412 (WRCRWA), and 424 (Brine Line) Sewer System Local Limits Regulations. Includes Control Authority numeric limits for each of the District's service areas.
- Ordinance 413 FOG Regulation. Includes FOG regulations for the whole JCSD service area to protect human health, the environment and the sewer system.
- Resolution 2399 Brine Line Enforcement Response Plan Details the Brine Line Enforcement Response Plan

The Ordinances and Resolutions listed above pertain to the legal authority required for fulfillment of SSMP requirements. These ordinances are accessible in full on Jurupa Community Services District website at www.jcsd.us. Portions of these ordinances are discussed in the following subsections as they pertain to the prevention of illicit discharges, proper design and construction of sewer and connections, maintenance access, and enforcement measures.

3.4 Prevention of Illicit Discharges

All measures prohibiting illicit discharges are included in Ordinances 226, 412, 413 and 423, Industrial Waste Ordinances. JCSD Ordinances 227, 412, 424 and 425 set specific numeric concentration limits to protect the sewer system, treatment plant and environment. The specific purpose of the regulations are to prevent the discharge of any pollutant into the sewers that would obstruct or damage the collection system, interfere with treatment, or threaten harm to human health or the environment. Examples of illicit discharges covered are included below. Refer to the District's Ordinance 226, 412 and 423 online at www.jcsd.us for the complete text.

- Stormwater and I/I. Ord 226, Section 2.20.30 prohibits discharge of any substance directly into a manhole or other opening in a District sewer, except through an approved building sewer. Section 3.2.31H prohibits discharge of unpolluted water, including stormwater, into a sanitary sewer through direct or indirect connection, unless the District has issued a permit.
- Industrial Waste. Section 3 and its subsections requires all industrial waste dischargers to obtain a permit and prohibits discharge in excess of the permit allowance. The

permit issued may require pretreatment or include other provisions for wastewater quality and quantity. It also requires periodic reporting by permit holders.

- Other Discharges. Section 3.2 prohibits discharge of any waste that could by itself or by interaction with other waste could, among other requirements, endanger human health, cause damage to the sewer system or extra collection, treatment, or disposal cost, create a nuisance, affect the treatment process, or impact treated water quality. Section 3.2 sets forth standards or prohibits discharge of several components, including (but not limited to) dyes, explosives, organic solvents, radioactive waste, solids, and toxic substances.

3.5 Proper Design and Construction of Sewers and Connections

Regulations pertaining to the design, construction, and inspection of building sewers and connections are included in District Ordinance 5 and 35. The District's Standards Manual and Developer's Handbook also have requirements for construction of sewers.

- Permit Required. Ordinance 5, Section 2 requires a permit prior to connecting to a public sewer. Section 2 of the Ordinance lays out the requirements for obtaining a permit. The permit application may include review of plans and specifications by the District. The District does not have permitting and approval authority for on-site sewer systems, that is the responsibility of Riverside County's Department of Building and Safety. However, the County and Cities do require District authorization in the form of a "Will Serve Letter" before providing sewer service to a building.
- Design Requirements. Ordinance 5, Section 6&7 specify the minimum size and slope of a building sewer, as well as the number of connections allowed to the building sewer. These sections also provide regulations for sewers of adjacent buildings, old building sewers, and cleanouts.
- Construction Requirements. Ordinance 5, Section 2 requires that construction of building sewers be in accordance with District requirements and that in case of conflict, the more stringent shall apply.
- Inspection and Testing. The inspection and testing of sewer laterals is conducted by Riverside County's Department of Building and Safety. However, the District is authorized under Ordinance 5, Section 11 for "inspection and approval of the construction of all street connections and house sewers to be built in said district". The District is also guaranteed "right of entry upon any private property for the purpose of making a record of the location of the house sewers", currently known as a sewer mapping.

3.6 Lateral Maintenance Access

Property owners are responsible for maintaining the street and house lateral all the way to the main sewer, including reconstruction and repair, per Ordinance 78.

3.7 Limit Discharge of FOG and Other Debris

Jurupa Community Services District's Ordinance 413 prohibits grease disposal, including discharge to any public or private sanitary sewer, and requires a gravity separation interceptor for

commercial or industrial grease generators. This ordinance also includes requirements for cleaning gravity separation interceptors.

Discharge of debris would be covered by the Prohibited Waste Discharge Requirements Ordinance 413, Section 3.1, which, among other things, prohibits discharge of any waste that could create a nuisance, cause damage to the sewer system or cause extra collection, treatment, or disposal cost.

3.8 Legal Authority

Legal measures available to the District to control sources of FOG under Ordinance 413 include the following:

- Authority to prohibit discharges
- Requirement of grease removal device and cleaning log
- Enforcement measures, as appropriate

The District also has necessary authority to control discharges to the sewer under Ordinances 226, 412 and 423 within the relevant portion of the sewer system tributary area, Riverside, WRCRWA and Brine Line respectively.

- a. Legal authority to prohibit discharges:
 - i. Authority to Control Discharges to the Sewer: Prohibited Waste Discharges
 1. District Ordinance 226, Section 2.1
 2. District Ordinance 412, Section 2.1
 3. District Ordinance 423, Section 104
 - ii. Prohibition of FOG Disposal in the Sewer:
 1. District Ordinance 413, Section 2.3
 - iii. Inspection: Provides the District with the legal authority to inspect any facility connected to the District's sewer system to verify compliance with District discharge requirements, including FOG requirements.
 1. District Ordinance 226, Section 2.4 and 2.5
 2. District Ordinance 412, Section 7.1
 3. District Ordinance 423, Section 502

3.9 Enforcement Measures

Different enforcement measures are available for enforcement of sewer provisions in Ordinance 5, Section 12. Due to the age of the Ordinance, the amounts of criminal and civil liability may need to be updated.

Ordinances 226, 412, 413 and 423 and Resolution 2399 includes escalating enforcement measures for violations of provisions included in those Ordinances. Written notice is provided to persons in violation, with a time limit for correction. Further enforcement provisions include declaration of a public nuisance and disconnection from public sewers. The person in violation is

liable to the District for expense, loss, or damage resulting from the violation. Ultimately, civil and criminal penalties may be imposed for violations of Ordinances.

Attachment E3-A: JCSD Ordinance 5 -
Sewer Use Ordinance

ORDINANCE NO. 5

AN ORDINANCE OF THE JURUPA COMMUNITY SERVICES DISTRICT OF RIVERSIDE COUNTY, CALIFORNIA, REGULATING AND PROVIDING FOR THE INSTALLATION AND INSPECTION OF CONNECTIONS TO MAIN SEWER LINE, AND FOR THE ISSUANCE OF PERMITS FOR SUCH INSTALLATION.

BE IT ORDAINED BY the Board of Directors of Jurupa Community Services District as follows:

SECTION 1. Definitions: The following words and phrases when used in this Ordinance have the following meaning:

LOT: A lot is hereby defined to be any piece or parcel of land as bounded, defined or shown upon the latest map, plan or deed recorded in the office of the County Recorder of Riverside County, California, or upon the Assessor's Map as prepared by the Assessor of Riverside County, California.

BUILDING: A building is a structure entirely separated from any other structure by a space or by walls in which there are no communicating doors or windows or similar openings.

FIXTURE: A fixture is any plumbing or sewer outlet requiring a trap or vent.

MAINSEWER: A Main sewer is a main pipe line sewer of the District laid in the streets, alleys, and easements, provided for the collection of sewage from street connections and house sewers and conveying same to the District outfall sewers.

SEWER CONNECTION: A sewer connection is any connection which is made to a main sewer.

STREET CONNECTION: A street connection is that portion of the sewer system which extends from the main sewer to the property line of a lot.

HOUSE SEWER: A house sewer is that portion of the horizontal piping extending from a point two feet from the foundation wall of the building to its connection with the street sewer connection.

**Attachment E3-B: JCSD Ordinance 35 –
Update Prohibited Inflows and Sewer
Construction**

ORDINANCE NO. 35

AN ORDINANCE OF JURUPA COMMUNITY SERVICES DISTRICT
AMENDING ORDINANCE NO. 5 TO PROHIBIT CONNECTIONS
FROM INFLOW SOURCES AND ADOPTING REGULATIONS FOR
SEWERAGE CONSTRUCTION

BE IT ORDAINED by the Board of Directors of Jurupa
Community Services District as follows:

Section 1. Amendment of Ordinance No. 5.

Section 8 of Ordinance No. 5 shall be and is hereby
amended to read in full as follows:

"Section 8. Prohibited Connections and Discharges.

"8.1 Inflow Sources. No person shall discharge
or cause to be discharged any rainwater, stormwater,
groundwater, street drainage, subsurface drainage, or
yard drainage, including evaporative type air cooler
water, into any sewerage facility which is directly
or indirectly connected to the District's sewer system.

"8.2 Steam Exhaust. No steam exhaust shall be
connected to any District sewer main; provided that,
a steam exhaust may be connected to a steam condenser
and the condensation pipe from such steam condenser
may be connected to such a main if the temperature of
the water discharged is less than 140° Fahrenheit.

"8.3 Trade Wastes. No garage, hotel, boarding
house, factory, laundry or any other place of business

Attachment E3-C: JCSD Ordinance 78 –
Sewer Lateral Responsibility

ORDINANCE NO. 78

AN ORDINANCE OF THE JURUPA COMMUNITY SERVICES
AMENDING THE RULES AND REGULATIONS FOR THE
PROVISION OF SEWER SERVICE, INCORPORATING
EXISTING POLICY REGARDING RESPONSIBILITY FOR
MAINTENANCE AND REPAIR OF CONNECTIONS TO
SEWERMAINS

BE IT ORDAINED BY THE BOARD OF DIRECTORS OF JURUPA
COMMUNITY SERVICES DISTRICT ("District") AS FOLLOWS:

Section 1. Findings. This Board of Directors
finds as follows:

(a) The District's rules and regulations providing for the installation and inspection of connections to sewer mains and for the issuance of permits for such installation are set forth in Ordinance No. 5 and have been amended by Ordinance No's. 35 and 71 (hereinafter "Sewer Regulations").

(b) As a matter of longstanding practice and policy the District has been responsible for the maintenance and repair of only the main sewer and not sewer connections, street connections, or house sewers as defined in Ordinance No. 5 of the Sewer Regulations.

(c) The Sewer Regulations do not establish responsibility for maintenance and repair of connections made to main sewers.

(d) The Board of Directors finds it necessary to incorporate by Ordinance the established policy for maintenance and repair of connections made to the main sewer as described in (b) above which policy recognizes that the District should not be responsible for performing maintenance or making repairs which may be necessary as a result of activities conducted on or adjacent to private property over which the District has no control.

Attachment E3-D: JCSD Ordinance 226 –
Riverside Area Industrial Waste Ordinance

ORDINANCE NO. 226

**AN ORDINANCE OF THE JURUPA COMMUNITY SERVICES DISTRICT,
CALIFORNIA, REPEALING JURUPA COMMUNITY SERVICES DISTRICT
ORDINANCE NO. 118 AND JURUPA COMMUNITY SERVICES DISTRICT
ORDINANCE NO. 133 AND ENACTING A NEW ORDINANCE RELATING TO THE
DISCHARGE OF WASTES INTO THE SEWER SYSTEMS OF THE JURUPA
COMMUNITY SERVICES DISTRICT.**

The Board of Directors of Jurupa Community Services District does ordain as follows:

Section 1: Jurupa Community Services District Ordinance 118 and Jurupa Community Services District Ordinance 133 are repealed.

Section 2: Jurupa Community Services District Ordinance No. 226 shall read as follows:

Ordinance No. 226 DISCHARGE OF WASTES INTO THE PUBLIC SEWER.

I. PREAMBLE-DEFINITIONS

- 1.1.3 Ordinance Purpose - Implementation of Regional Board Ordinance
- 1.2.4 Definitions

II. GENERAL PROVISIONS

- 2.1.14 Administration
- 2.2.16 Notice
- 2.3.16 Confidentiality
- 2.4.16 Inspection
- 2.5.17 Inspection Warrants
- 2.6.17 Monitoring
- 2.7.21 Flow Measurement
- 2.8.21 Infectious Waste Disposal
- 2.9.22 Water Softening Restrictions
- 2.10.25 Gravity Separation Interceptor
- 2.11.25 Interceptor Requirements
- 2.12.26 Standard Interceptor Designs
- 2.13.26 Interceptor Maintenance
- 2.14.27 Restaurants
- 2.15.28 Prohibited Restaurant Surface Discharges
- 2.16.28 Conditional Waivers
- 2.17.29 Liquid Waste Haulers
- 2.18.29 Use of and Damage to District Equipment or Facilities
- 2.19.29 Surface Discharge Prohibitions

- 2.20.30 Point of Discharge Limitation
- 2.21.30 Time Limits

III. INDUSTRIAL WASTES

- 3.1.30 Separation of Domestic and Industrial Waste
- 3.2.31 Prohibited Waste Discharges
- 3.3.34 Swimming Pool Discharge Requirements
- 3.4.34 Limitation on Wastewater Strength
- 3.5.35 Local Limits
- 3.6.35 DeMinimus Categorization
- 3.7.36 Pretreatment of Industrial Wastewaters
- 3.8.36 Unauthorized Monitoring and Pretreatment Equipment Modifications
- 3.9.37 Pretreatment Equipment Bypass
- 3.10.37 Prohibited Discharge of Recovered Pretreatment Waste
- 3.11.37 Dilution Prohibited as a Substitute for Treatment
- 3.12.38 Stormwater Diversion
- 3.13.38 Industrial User Modifications
- 3.14.39 Spill Containment System
- 3.15.39 Facility Waste Management Plan
- 3.16.41 Federal Categorical Pretreatment Standards
- 3.17.42 Notice of Potential Problems to POTW
- 3.18.42 Written Responses
- 3.19.42 Falsifying Information
- 3.20.42 Wastewater Discharge Authorization Certificates
- 3.21.42 Industrial User Group Permits
- 3.22.43 Industrial User Permits
- 3.23.48 Permit Duration
- 3.24.48 Duty To Comply
- 3.25.49 Permit Renewal
- 3.26.49 Permit Modifications
- 3.27.50 Permit Transfer
- 3.28.50 Charges and Fees
- 3.29.51 Assessment of Permit Fees and Charges
- 3.30.51 Payment of Fees, Charges and Penalties; Late Payment

IV. ENFORCEMENT

- 4.1.52 Enforcement Response Plan (ERP)
- 4.2.52 Administrative Violations
- 4.3.53 Violations of Discharge Limitations
- 4.4.54 Unclassified Violations
- 4.5.55 Administrative Orders
- 4.6.59 Termination of Service
- 4.7.60 Publication Notice
- 4.8.60 Civil Penalties
- 4.9.60 Criminal Penalties

4.10.61	Probationary Periods
4.11.61	Remedies Nonexclusive
4.12.61	Judicial Collection
4.13.62.	Damage to Facilities or Interruption of Normal Operations
4.14.62.	Appeals
4.15.63.	Alternative Enforcement Procedures
4.16.63	Invalidity
4.17.63	Interpretation-- Intent

I. Preamble--Definitions

Section 1.1.3 Ordinance Purpose--Implementation of Regional Board Ordinance. The sewage collection system of Jurupa Community Services District (District) discharges wastewater to various Publicly Owned Treatment Works (POTW). The POTW's discharge treated effluent into surface waters of the United States of America and the State of California, in particular the Pacific Ocean and the Santa Ana River. Specifically, the District's collection system discharges wastewater to three different wastewater treatment plants. First, the City of Riverside's Water Pollution Control Plant, which discharges to the Santa Ana River. Second, the Santa Ana Regional Interceptor, which discharges to County Sanitation Districts of Orange County Treatment Plant, which discharges to the Pacific Ocean. Third, the West Riverside County Regional Wastewater Authority's Treatment Plant, which discharges to the Santa Ana River. The chemical nature of these effluents affects the quality of water existing in the receiving waters as well as the quality of underground waters in the vicinity.

The California Regional Water Quality Control Board, Santa Ana Region, (Regional Board), has established discharge limitations for the chemical content of sewage effluent discharged by the District and the contracted treatment agencies. These limitations are set forth from time to time in duly enacted ordinances and orders of the Regional Board.

A. This Ordinance shall provide for the regulation of wastewater discharges in accordance with the federal government's objectives of general pretreatment regulations as stated in Section 403.2 of Title 40 of the Code of Federal Regulations (CFR) and amendments thereto which are for the following purposes:

1. To prevent the introduction of pollutants into the POTWS which will interfere with the operation of the POTWS; including interference with its use or disposal of municipal biosolids;
2. To prevent the introduction of pollutants into the POTWS which will pass through the treatment works, inadequately treated, to the receiving waters or otherwise be compatible with such works;

Attachment E3-E: JCSD Ordinance 227 –
Riverside Area Local Limit Ordinance

ORDINANCE NO. 227

AN ORDINANCE OF JURUPA COMMUNITY SERVICES DISTRICT, ESTABLISHING MAXIMUM CONCENTRATION LEVELS OF INDUSTRIAL WASTEWATER AND CONVENTIONAL POLLUTANTS AND STRENGTH BASED SURCHARGES IN ACCORDANCE WITH THE PROVISIONS OF ORDINANCE NO. 226 RELATING TO THE DISCHARGE OF WASTES INTO THE SEWER SYSTEMS OF JURUPA COMMUNITY SERVICES DISTRICT TRIBUTARY TO THE CITY OF RIVERSIDE WASTEWATER TREATMENT PLANT; AND REPEALING ORDINANCE NO. 135

WHEREAS, the National Pollutant Discharge Elimination System Permit issued to the City of Riverside requires that the City adopt an ordinance regulating the discharge of industrial wastes; and

WHEREAS, Jurupa Community Services District and the City of Riverside entered into a Pretreatment Agreement to Implement, Administer and Enforce an Industrial Wastewater Pretreatment Program (Pretreatment Agreement) on October 26, 1999; and

WHEREAS, Section 2.2 and Section 8 of the Pretreatment Agreement mandate that Jurupa Community Services District adopt local limits that are "no less stringent and broad in scope" as the City of Riverside's local limits; and

WHEREAS, on December 23, 1996, Jurupa Community Services District upon the adoption of Ordinance No. 133, adopted Ordinance No. 135, establishing the maximum concentration levels of industrial wastewater and conventional pollutants and applicable surcharge rates in accordance with Ordinance No. 133; and

WHEREAS, the City of Riverside adopted Ordinance No. 6232 on November 12, 2002, amending Chapter 14.12 of the Riverside Municipal Code to provide the necessary regulations for the discharge of industrial waste into the public sewerage and storm water systems of the City; and

WHEREAS, the Jurupa Community Services District adopted Ordinance No. 226 on September 26, 2005, repealing Ordinance No. 133 and enacting a new ordinance relating to the discharge of wastes into the sewer systems of the Jurupa Community Services District; and

WHEREAS, the City of Riverside has adopted Resolution 20295 on November 5, 2002, implementing maximum allowable concentration levels (local limits); and

WHEREAS, the Jurupa Community Services District must now repeal Ordinance No. 135 and establish maximum allowable concentration levels of industrial wastewater and conventional pollutants strength based surcharge rates in accordance with Ordinance No. 226.

NOW THEREFORE, BE IT ORDAINED by the Board of Directors of the Jurupa Community Services District, as follows:

Section 1: The Board of Directors of the Jurupa Community Services District does hereby establish the following maximum concentration levels of industrial wastewater pollutants and conventional pollutants in Table I and applicable surcharge rates (strength based surcharges) in Table II in accordance with Jurupa Community Services District Ordinance 226, which regulate the discharge of industrial waste into the sewerage system of the Jurupa Community Services District.

**TABLE I
INDUSTRIAL WASTEWATER POLLUTANT LIMITATIONS**

Pollutant	Concentration (mg/l)
Arsenic	1.8
Boron	5.2
COD	8,000
Cadmium	.15
Chloride	350
Chromium	0.68
Copper	3.0
Cyanide	0.17
Fluoride	12
Lead	1.2
Manganese	1.0
Mercury	.001
Nickel	2.3
Oil & Grease	250
Phenol	(-)
Silver	.8,50¹

The lower silver limit will apply to all non-domestic discharges. The higher limit will apply to all non-domestic dischargers, of silver bearing wastewater, who are: 1) properly registered by the District, 2) employ approved pretreatment equipment which reduces the silver concentration to acceptable levels, and 3) have applied for and been issued the higher limit by the District.

Sodium	250
Sulfate	250
Total Dissolved Solids	2500
Total Hardness	2500
Total Nitrogen	500
TSS	2000
Total Toxic Organics	(-)
Zinc	6.7

CERTIFICATION

I, CAROLE A. MCGREEVY, Secretary of the Board of Directors of Jurupa Community Services District, certify that the foregoing ordinance was introduced at a regular meeting of the Board of Directors on the 9th day of January, 2006 and was adopted by the Board of Directors at a regular meeting held on the 10th day of April, 2006, by the following vote of the Directors:

AYES:

NOES:

ABSENT:

ABSTAINED:

IN WITNESS WHEREOF, I have hereunto set my hand and affixed the official seal of Jurupa Community Services District this ____ day of _____, 2006.

Secretary of the Board of Directors

**TABLE II
STRENGTH BASED SURCHARGE**

Pollutant	(mg/L)	\$/lb
Chemical Oxygen Demand	8,000	\$0.080
Oil & Grease	250	\$0.500
Total Nitrogen	500	\$0.040
Total Suspended Solids	2,000	\$0.185

The Strength Based Surcharge (SBS) shall be applied to all monitored permitted industrial user wastewater discharges. The pounds of a pollutant shall be calculated by the following formula:

$$\text{Pounds} = \text{PC} \times \text{Q} \times 8.34$$

Where: PC= pollutant concentration in mg/L-maximum limitation concentration in mg/L


Q=flow of wastewater in million gallon units

The SBS shall be assessed for the total time period represented by the sample analysis.


Section 2: Ordinance No. 135 is hereby repealed in its entirety.

Section 3: This Ordinance shall become effective thirty (30) days from the date of its adoption.

ADOPTED by the Board of Directors and signed by the President of the Board of Directors and attested by the Secretary of the Board of Directors this 10th day of April, 2006.


President of the Board of Directors

Attest:

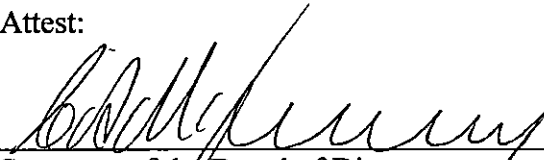
Secretary of the Board of Directors

Attachment E3-F: JCSD Ordinance 412 –
WRCRWA Area Industrial Waste Ordinance

ORDINANCE NO. 412

**ORDINANCE OF JURUPA COMMUNITY SERVICES
DISTRICT ESTABLISHING REQUIREMENTS FOR
WESTERN RIVERSIDE COUNTY REGIONAL
WASTEWATER AUTHORITY (WRCRWA) SERVICE AREA
WASTEWATER USE**

**BE IT ORDAINED BY THE BOARD OF DIRECTORS OF JURUPA
COMMUNITY SERVICES DISTRICT AS FOLLOWS:**

TABLE OF CONTENTS

SECTION 1	GENERAL PROVISIONS	4
1.1	Purpose and Policy	4
1.2	Administration	4
1.3	Abbreviations	5
1.4	Definitions	5
SECTION 2	GENERAL SEWER USE REQUIREMENTS	13
2.1	Prohibited Discharge Standards	13
2.2	National Categorical Pretreatment Standards	15
2.3	Local Limits	15
2.4	Authority's Right of Revision	16
2.5	Dilution	16
SECTION 3	PRETREATMENT OF WASTEWATER	17
3.1	Pretreatment Facilities	17
3.2	Additional Pretreatment Measures	17
3.3	Accidental Discharge/Slug Discharge Control Plans	17
3.4	Bypass	18
3.5	Hauled Wastewater	19
SECTION 4	INDIVIDUAL WASTEWATER DISCHARGE PERMITS	19
4.1	Wastewater Analysis	19
4.2	Individual Wastewater Discharge Permit Requirement	20
4.3	Individual Wastewater Discharge Permitting: Existing Connections	20
4.4	Individual Wastewater Discharge Permitting: New Connections	20
4.5	Individual Wastewater Discharge Permit Application Contents	20
4.6	Application Signatories and Certifications	22
4.7	Individual Wastewater Discharge Permit Decisions	22
SECTION 5	INDIVIDUAL WASTEWATER DISCHARGE PERMIT ISSUANCE	23
5.1	Individual Wastewater Discharge Permit Duration	23
5.2	Individual Wastewater Discharge Permit Contents	23

Attachment E3-G: JCSD Ordinance 413 –
FOG Ordinance (All Areas)

ORDINANCE NO. 413

ORDINANCE OF JURUPA COMMUNITY SERVICES DISTRICT RELATING TO THE DISCHARGE OF FATS, OILS AND GREASES (FOG) WASTES INTO THE PUBLIC SEWER SYSTEMS OF JURUPA COMMUNITY SERVICES DISTRICT AND SUPERSEDING INCONSISTENT PROVISIONS IN ORDINANCE NOS. 226, 380 AND 412

TABLE OF CONTENTS

SECTION 1 PREAMBLE—DEFINITIONS.....3
1.1 Ordinance Purpose--Implementation of Regional Board Ordinance.....3

SECTION 2 GENERAL PROVISIONS8
2.1 Administration.....8
2.2 Notice10
2.3 FOG Discharge Requirement10
2.4 Enforcement of Chapter10
2.5 Right of Entry11
2.6 Inspection Warrants.....12
2.7 Monitoring12
2.8 Requirements for Best Management Practices14
2.9 Gravity Separation Interceptor (GSI) Requirements16
2.10 Gravity Separation Interceptor (GSI) Design17
2.11 Gravity Separator Interceptor Maintenance.....18
2.12 Restaurants19
2.13 Prohibited Restaurant Surface Discharges20
2.14 Conditional Waivers.....20
2.15 Record Keeping Requirements.....20
2.16 Liquid Waste Haulers.....21
2.17 Surface Discharge Prohibitions.....21
2.18 Notification of Spill22
2.19 Private Sewer Lateral Maintenance Requirement22
2.20 Point of Discharge Limitation22

SECTION 3 FOG DISCHARGE WASTES23
3.1 Prohibited Waste Discharges.....23
3.2 Pretreatment of FOG Wastewater24
3.3 Unauthorized Monitoring and Pretreatment Equipment Modifications24
3.4 Pretreatment Equipment Bypass.....25
3.5 Dilution Prohibited as a Substitute for Treatment.....25
3.6 Notice of Potential Problems to General Manager25
3.7 Written Responses.....26
3.8 Falsifying Information.....26
3.9 FOG Discharge Permits.....26
3.10 FOG Discharge Permit Duration26
3.11 Duty to Comply.....27
3.12 Assessment of Permit Fees and Charges.....27

3.13	Payment of Fees, Charges and Penalties; Late Payment.....	27
------	---	----

SECTION 4 ENFORCEMENT27

4.1	Enforcement Response Plan (ERP).....	27
4.2	Administrative Violations.....	27
4.3	Violations of Discharge Limitations.....	29
4.4	Unclassified Violations.....	30
4.5	Administrative Orders.....	30
4.6	Termination of Service.....	34
4.7	Civil Penalties.....	34
4.8	Criminal Penalties.....	35
4.9	Probationary Periods.....	36
4.10	Remedies Nonexclusive.....	36
4.11	Judicial Collection.....	36
4.12	Damage to Facilities or Interruption of Normal Operations.....	36
4.13	Sewer System Overflows and Cleanup Costs.....	37
4.14	Appeals.....	37
4.15	Alternative Enforcement Procedures.....	38
4.16	Invalidity.....	38
4.17	Interpretation--Intent.....	38
4.18	Effective Date.....	38

**Attachment E3-H: JCSD Ordinance 423 –
Brine Line Area Industrial Waste Ordinance**

ORDINANCE NO. 423

AN ORDINANCE OF THE JURUPA COMMUNITY SERVICES DISTRICT ESTABLISHING REGULATIONS FOR THE USE OF THE JURUPA COMMUNITY SERVICES DISTRICT SEWER SYSTEM TRIBUTARY TO THE INLAND EMPIRE BRINE LINE

BE IT ORDAINED BY THE BOARD OF DIRECTORS OF JURUPA COMMUNITY SERVICES DISTRICT AS FOLLOWS:

PREAMBLE

**ARTICLE 1
GENERAL PROVISIONS**

- 101.0 Purpose and Policy
- 102.0 Authorization
- 103.0 Definitions
- 104.0 Administration
- 105.0 Notice
- 106.0 Confidentiality
- 107.0 Time Limits

**ARTICLE 2
GENERAL PROHIBITIONS AND
LIMITATIONS ON DISCHARGES**

- 201.0 Prohibited Waste Discharges
- 202.0 Dilution Prohibited as a Substitute for Treatment
- 203.0 Limitations on Groundwater, Surface Runoff, and Subsurface Drainage
- 204.0 Limitations on Unpolluted Water
- 205.0 Limitations on Domestic Wastewater and Septage Waste
- 206.0 Limitations on Point of Discharge
- 207.0 Limitations on the Use of Grinders
- 208.0 Limitations on Biochemical Oxygen Demand (BOD)
- 209.0 Limitations on Infectious Waste Disposal
- 210.0 Limitations on Disposal of Spent Solutions and Sludges
- 211.0 Slug Discharges
- 212.0 Limitations on Wastewater Originating from Outside the Service Area

213.0 Federal Categorical Pretreatment Standards

**ARTICLE 3
WASTEWATER DISCHARGE CONTRACTS
USER CHARGES AND FEES**

- 301.0 Introduction
- 302.0 Wastewater Discharge Contract between SAWPA and JCSD
- 303.0 Wastewater Discharge Contracts Between JCSD and a User of the Brine Line or Tributaries Thereto
- 304.0 User Charges and Fees

**ARTICLE 4
WASTEWATER DISCHARGE PERMITS**

- 401.0 Introduction
- 402.0 Wastewater Discharge Permits
- 403.0 Permit Duration
- 404.0 Duty to Comply
- 405.0 Permit Renewal, Extension and Fees
- 406.0 Permit Modifications
- 407.0 No Permit Transfer or Assignment
- 408.0 Wastewater Discharge Contract Capacity Rights
- 409.0 Operational Emergency Discharge
- 410.0 Liquid Waste Hauler Permits (Reserved)
- 411.0 Collection Stations (Reserved)
- 412.0 Groundwater, Surface Runoff, and Subsurface Drainage
- 413.0 Wastewater from Outside the SAWPA Brine Line Service Area

**ARTICLE 5
MONITORING, REPORTING, INSPECTION,
AND FACILITY REQUIREMENTS**

- 501.0 Monitoring and Reporting
- 502.0 Inspection
- 503.0 Inspection Warrants
- 504.0 Record Keeping
- 505.0 Flow Measurement
- 506.0 Interceptor Requirements
- 507.0 Standard Interceptor Designs
- 508.0 Interceptor Maintenance
- 509.0 Liquid Waste Haulers (Reserved)

- 510.0 Use of and Damage to JCSD and/or SAWPA Equipment or Facilities
- 511.0 Separation of Domestic and Industrial Waste
- 512.0 Limitations on Wastewater Strength
- 513.0 Local Limits
- 514.0 Pretreatment of Industrial Wastewaters
- 515.0 Unauthorized Monitoring and Pretreatment Equipment Modifications
- 516.0 Pretreatment Equipment Bypass
- 517.0 Prohibited Discharge of Recovered Pretreatment Waste
- 518.0 Industrial User Modifications
- 519.0 Spill Containment Systems
- 520.0 Facility Waste Management Plan
- 521.0 Notice of Potential Problems to POTW
- 522.0 Written Responses
- 523.0 Falsifying Information

ARTICLE 6 ENFORCEMENT

- 600.0 Purpose and Scope
- 601.0 Enforcement Response Plan (ERP)
- 602.0 Administrative Violations
- 603.0 Violations of Discharge Limitations
- 604.0 Unclassified Violations
- 605.0 Separate Violations
- 606.0 Administrative Orders
- 607.0 Wastewater Discharge Permit Revocation
- 608.0 Termination of Service
- 609.0 Annual Publication Notice
- 610.0 Administrative Complaint
- 611.0 Emergency Suspension
- 612.0 Civil Liability for Violations
- 613.0 Criminal Penalties
- 614.0 Legal Action
- 615.0 Supplemental Enforcement Actions
- 616.0 Remedies Nonexclusive
- 617.0 Payment of Fees, Charges, and Penalties
- 618.0 Damage to Facilities or Interruption of Normal Operations
- 619.0 Appeals
- 620.0 Alternative Enforcement Procedures
- 621.0 Invalidity
- 622.0 Interpretation -- Intent

ARTICLE 7
MISCELLANEOUS PROVISIONS

- 700.0 Severability
- 701.0 Effective Date
- 702.0 Judicial Review of Ordinance

Attachment E3-I: JCSD Ordinance 424 –
Brine Line Area Local Limit Ordinance

ORDINANCE NO. 424

AN ORDINANCE OF THE BOARD OF DIRECTORS OF THE JURUPA COMMUNITY SERVICES DISTRICT ESTABLISHING LOCAL LIMITS AND BEST MANAGEMENT PRACTICES REQUIREMENTS FOR THE USE OF THE JURUPA COMMUNITY SERVICES DISTRICT SEWER SYSTEM TRIBUTARY TO THE INLAND EMPIRE BRINE LINE

WHEREAS, the Board of Directors of the Jurupa Community Services District ("JCSD") adopted Ordinance No. 423 an Ordinance Establishing Regulations for the Use of the Jurupa Community Services District Sewer System Tributary to the Inland Empire Brine Line ("Brine Line"); and

WHEREAS, Article 2 of Ordinance No. 423 requires the prevention of discharges which are detrimental to JCSD and Brine Line operations and could cause sanitary sewer overflows; and

WHEREAS, Section 513.0 of Ordinance No. 423 provides for the establishment and implementation of pollutant limitations that are technically developed as Local Limits by Orange County Sanitation District (hereinafter "OCSD") pursuant to 40 Code of Federal Regulations 403.5(c) and amendments thereto; and

WHEREAS, high concentrations of Biochemical Oxygen Demand (BOD) and Fats, Oils, and Grease (FOG) have been detrimental to JCSD and Brine Line operations necessitating limits and standards regarding concentration; and

WHEREAS, significantly high concentrations of BOD have the potential to cause adverse effects to JCSD operations and the Brine Line and implementation of effective Best Management Practices ("BMPs") should substantially lower the incidence of said discharges; and

WHEREAS, it has been determined the Local Limit previously developed for the parameter of Dissolved Organic Carbon ("DOC") is no longer necessary; and

WHEREAS, OCSD developed new prohibitions, limitations, and requirements with the establishment of Ordinance No. OCSD-48; and

WHEREAS, limitations and requirements are necessary to assure compliance with OCSD's National Pollutant Discharge Elimination System ("NPDES") Permit and JCSD's obligations, including the prohibition against pass through of any pollutants that can cause a violation of the NPDES Permit or cause an interference with a Publicly Owned Treatment Works ("POTW"), to protect POTW workers, to reclaim and reuse municipal waters and sludges, and to comply with agreements between the Santa Ana Watershed Project Authority, OCSD and JCSD.

NOW, THEREFORE, BE IT RESOLVED that the Board of Directors of the Jurupa Community Services District hereby establishes, determines, and orders:

Section 1. The following Local Limits and Best Management Practices (BMP) Requirements are hereby adopted:

LOCAL NON-DOMESTIC WASTEWATER LIMITATIONS CONCENTRATION VALUES

Pollutant ⁽¹⁾	Maximum Daily Limit (mg/L)
1,4-dioxane	1.0
Arsenic	2.0
Cadmium	1.0
Chromium (Total)	20.0
Copper	3.0
Lead	2.0
Mercury	0.03
Nickel	10.0
Selenium	3.9
Silver	15.0
Zinc	10.0
Cyanide (Total)	5.0
Molybdenum	2.3
Polychlorinated biphenyls (PCB)	0.01
Pesticides	0.01
Sulfide (Total)	5.0
Sulfide (Dissolved)	0.5
Oil and Grease (Mineral/Petroleum Oil Origin) ⁽²⁾	100.0
Fats, Oil and Grease (FOG)	500.0

⁽¹⁾ Users subject to Federal Categorical Pretreatment Standards may be required to meet more stringent limits.

⁽²⁾ Oil and Grease of mineral or Petroleum Origin is also known as Petroleum Oil and Grease Silica Gel Treated n-Hexane Extractable Material.

MASS (LBS/DAY) LIMITATION

Pollutant	Maximum Daily Limit (lbs/day)
Ammonia	Report (**)
Biochemical Oxygen Demand	Report (**)

(**) Users may be required to monitor for and report the analytical results for required parameters at a frequency as specified in a wastewater discharge permit or other control mechanism.

BEST MANAGEMENT PRACTICES (BMP) REQUIREMENTS**

Pollutant	Average Daily Concentration (mg/L) During any Month
Biochemical Oxygen Demand	12,000

**** BMP Requirements apply to permitted users with flow volumes greater than 5,000 gpd (calculated as a seven-day average) which cannot achieve consistent compliance with the BMP demonstration value listed above. Said users shall be required, as a condition of their Waste Discharge Permit, to develop BMPs which include, but are not limited to:**

- a. Identifying and evaluating the source and volumes of pollutants being discharged to the Brine Line;
- b. Implementing spill prevention and countermeasures plans;
- c. Evaluating additional treatment or disposal options; and
- d. Evaluating recycle or reuse opportunities.

Section 2. pH shall be between 6.0 and 12.0.

Section 3. In those cases where a JCSD Industrial Non-Process Wastestream is comingled with a JCSD Industrial Process Wastestream, as defined by Ordinance No. 423, prior to a designated monitoring point the following Wastestream Correction Formula may be used to adjust the Local Limits to account for the presence of JCSD Industrial Non-Process Wastestreams:

$$C_A = \frac{C_C(\sum_{N=1}^M F_N)}{F_T}$$

Where: C_A = Adjusted Local Limit to account for Industrial Non-Process Wastestream(s)

C_C = Local Limit for the pollutant constituent

F_N = Average daily flow for JCSD Industrial Process Wastestream

F_T = Average daily flow for all wastestreams through the sample point

M = Total number of JCSD Industrial Process Wastestreams

Section 4. The Local Limits and BMP Requirements established by this Ordinance shall become effective immediately. Industry Specific BMP Requirements will be incorporated as a permit condition that includes a compliance schedule which shall not exceed one (1) year from the effective date of the permit change.

Section 5. All previous resolutions and ordinances, including but not limited to Ordinance 119, relating to Local Limits are hereby rescinded in their entirety.

Section 6. Adoption of this Ordinance is statutorily exempt from environmental review under the California Environmental Quality Act pursuant to the provisions of Public Resources Code Section 21080(b)(8) and California Code of Regulations Section 15273(a) and categorically exempt pursuant to California Code of Regulations Sections 15307 and 15308.

ADOPTED THIS 22nd day of January 2018.


President of the Board of Directors

ATTEST:


Secretary of the Board of Directors

CERTIFICATION

I, Julie B. Saba, Secretary of the Board of Directors of Jurupa Community Services District, certify that the foregoing ordinance was adopted at a regular meeting of the Board of Directors on 22nd day of January 2018, by the following vote of the Directors:

AYES: Betty A. Anderson, Jane F. Anderson, Richard 'Dickie' Simmons, Betty Folsom, Kenneth J. McLaughlin

NOES: None

ABSENT: None

ABSTAINED: None

IN WITNESS WHEREOF, I have hereunto set my hand and affixed the official seal of Jurupa Community Services District this 22nd day of January 2018.


Secretary of the Board of Directors

(SEAL)



Attachment E3-J: JCSD Ordinance 425 –
Riverside Area Local Limit Ordinance
Amendment

ORDINANCE NO. 425

AN ORDINANCE OF JURUPA COMMUNITY SERVICES DISTRICT AMENDING ORDINANCE NO. 227 TO CHANGE THE TOTAL DISSOLVED SOLIDS LOCAL LIMIT FOR INDUSTRIAL USERS TRIBUTARY TO THE CITY OF RIVERSIDE REGIONAL WATER QUALITY CONTROL PLANT

WHEREAS, Jurupa Community Services District provides wastewater collection service within its service area and, pursuant to a series of Regional Treatment Agreements conveys a portion of the wastewater to the Riverside Regional Water Quality Control Plant, owned by the City of Riverside, California, for treatment, and pursuant to the Pretreatment Agreement with the City of Riverside to Implement, Administer and Enforce an Industrial Wastewater Pretreatment Program dated October 26, 1999 (Pretreatment Agreement); and

WHEREAS, the National Pollutant Discharge Elimination System Permit issued to the City of Riverside requires the City to regulate the discharge of industrial wastewater; and

WHEREAS, Section 2.2 of Section 8 of the Pretreatment Agreement requires Jurupa Community Services District to adopt local limits that are no less stringent or broad in scope as the City of Riverside's local limits; and

WHEREAS, Jurupa Community Services District adopted Ordinance No. 226 on September 26, 2005, regulating the discharge of wastes into the District's sewer systems; and

WHEREAS, in accordance with Ordinance No. 226, Jurupa Community Services District adopted Ordinance No. 227 on January 9, 2006, establishing maximum concentration levels of industrial wastewater pollutants and conventional pollutants and establishing applicable surcharge rates; and

WHEREAS, the City of Riverside adopted Resolution No. 22286 on March 18, 2018, which changed the maximum concentration level of the industrial wastewater pollutant Total Dissolved Solids ("TDS") from 2500 mg/L to 1210 mg/L and permitted a mass-based and concentration-based limit for businesses with current licenses; and

WHEREAS, Jurupa Community Services District now desires to amend Ordinance No. 227 to change the maximum concentration level of TDS, to include mass- and concentration-based limits, and to delete strength based surcharges, because these surcharges are already provided for in Resolution No. 2512.

NOW THEREFORE, BE IT ORDAINED by the Board of Directors of the Jurupa Community Services District, as follows:

Section 1. Table I "Industrial Wastewater Pollutant Limitations" in Jurupa Community Services District Ordinance No. 227 is amended to change the maximum

concentration level of the industrial wastewater pollutant TDS from 2500 mg/L to 1210 mg/L. Attachment A to this Ordinance sets out the full list of all applicable local limits, including the TDS limit as revised by this Ordinance, in a single table.

Section 2. Table II “Strength Based Surcharge” and the text following Table II in Section 1 of Ordinance No. 227 are hereby deleted.

Section 3. Current Permitted Class I – III Industrial Users who are subject to Ordinance No. 227 prior to the adoption of this Ordinance may be allowed either a mass-based or a concentration-based limit, as determined by the District, using an average of that Industrial User’s certified TDS sampling results collected by the District and reported by the Industrial User from January 2016 through September 2017 (“TDS Average Sample Result”) and their maximum permitted flow limit, or a concentration-based limit of 1210 mg/L, whichever is higher. The mass-based limit must be calculated using the following formula:

$$\text{New TDS Effluent Limit \{lbs/day\}} = (\text{TDS Average Sample Result \{mg/L\}}) \times (8.34 \text{ \{lbs/gallon\}}) \times (\text{Current permitted maximum flow \{million gallons / day\}})$$

Section 4. Compliance with either the mass-based or the concentration-based TDS limit must be determined at the beginning of each quarter, from an average of the results of samples taken during the previous quarter by the District, and/or the Industrial User.

Section 5. Except as amended by this Ordinance, Ordinance No. 227 remains effective and enforceable.

Section 6. This Ordinance becomes effective 30 days from the date of adoption.

ADOPTED this 29th day of May 2018.


President of the Board of Directors

ATTEST:


Secretary of the Board of Directors

CERTIFICATION

I, Julie B. Saba, Secretary of the Board of Directors of Jurupa Community Services District, certify that the foregoing ordinance was introduced at a regular meeting of the Board of Directors on the 14th day of May 2018, and was adopted by the Board of Directors at a regular meeting held on the 29th day of May 2018, by the following vote of the Directors:

AYES: Betty A. Anderson, Jane F. Anderson, Richard "Dickie" Simmons, Betty Folsom, Kenneth J. McLaughlin

NOES: None

ABSENT: None

ABSTAINED: None

IN WITNESS WHEREOF, I have hereunto set my hand and affixed the official seal of Jurupa Community Services District this 29th day of May 2018.


Secretary of the Board of Directors

(SEAL)

**ATTACHMENT A
TO ORDINANCE NO. 425**

**TABLE I
INDUSTRIAL WASTEWATER POLLUTANT LIMITATIONS**

POLLUTANT	CONCENTRATION (MG/L)
Arsenic	1.8
Boron	5.2
COD	8,000
Cadmium	0.15
Chloride	350
Chromium	0.68
Copper	3.0
Cyanide	0.17
Fluoride	12
Lead	1.2
Manganese	1.0
Mercury	0.001
Nickel	2.3
Oil & Grease	250
Phenol	(-)
Silver	.8, 50 ¹
Sodium	250
Sulfate	250
Total Dissolved Solids	1,210
Total Hardness	2,500
Total Nitrogen	500
TSS	2,000
Total Toxic Organics	(-)
Zinc	6.7

¹ The lower silver limit will apply to all non-domestic discharges. The higher limit will apply to all non-domestic dischargers, of silver bearing wastewater, who are: 1) properly registered by the District, 2) employ approved pretreatment equipment which reduces the silver concentration to acceptable levels, and 3) have applied for and been issued the higher limit by the District.

Attachment E3-K JCSD Ordinance 433 –
Backwater Valve Ordinance

ORDINANCE NO. 433

AN ORDINANCE OF THE JURUPA COMMUNITY SERVICES DISTRICT PROVIDING FOR THE INSTALLATION, INSPECTION AND MAINTENANCE OF SEWER BACKWATER VALVES IN NEW CONSTRUCTION

WHEREAS, Jurupa Community Services District (District) provides sewer services within its 40.79 square-mile service area; and

WHEREAS, the topography of the District's service area is characterized by relatively flat areas and by areas of steep slope. As a result, there are many places within the service area where house sewers are flat, too close to main sewers, sagging, or obstructed. In addition, there are areas where main sewers are on steep slopes and may be under high pressure; and

WHEREAS, the topographic conditions in the District's service area and the resulting conditions present in house sewers and main sewers may contribute to instances of reverse flow during times when main sewers are near capacity or under high pressure; and

WHEREAS, sewer backwater valves are designed to prevent the backflow of sewage into structures connected to the main sewer through a house sewer; and

WHEREAS, the District hereby finds that it is reasonably necessary to require sewer backwater valves as a condition of new or continued service for all new construction, all reconstruction, and all sewer connections that experience damage from backflow conditions in order to mitigate instances of backflow of sewage into house sewers and buildings connected to main sewers.

NOW, THEREFORE, THE JURUPA COMMUNITY SERVICES DISTRICT HEREBY ORDAINS as follows:

Section 1. Definitions.

"Damage from backflow conditions" means damage to any real or personal property or the environment caused by a condition of backflow which could have been prevented through the use of a properly operating sewer backwater valve.

"Sewer backwater valve" means the same as "backwater valve" is defined in the California Plumbing Code and is a device installed in a drainage system to prevent reverse flow.

"Redevelopment" means the renovation, remodeling, tenant improvement, or other construction or reconstruction work that creates a new sewer connection or that adds a fixture to a structure and that fixture drains to the house sewer.

Section 2. As a condition to receiving service in any new construction or redevelopment and after damage from backflow conditions occurs, all fixtures draining to the main sewer must be protected from backflow of sewage by an approved type of sewer backwater valve. Cleanouts for drains that pass through a sewer backwater valve must be clearly identified with a permanent label stating "backwater valve downstream." The sewer backwater valve must also comply with the standards set forth in Standard Drawing S-5 attached to this ordinance and must be maintained in proper operating condition.

Section 3. Applicability.

This ordinance applies to all new construction, all redevelopment of any structure with a sewer connection, all sewer connections that experience damage from backflow conditions, and all existing backwater valves. Notwithstanding the preceding sentence, the General Manager may grant an exception to this ordinance, in the General Manager's sole discretion, on the grounds that installation of a sewer backwater valve increases the risk of backflow or overflow conditions or to maintain consistency with applicable laws or regulations.

Section 4. Severability.

If any provision, clause, sentence or paragraph of this ordinance or the application thereof to any person or circumstances is held invalid, such invalidity does not affect the other provisions of this ordinance which can be given effect without the invalid provision or application, and to this end the provisions of this ordinance are declared to be severable.

ADOPTED this 25th day of March 2019.



President of the Board of Directors

ATTEST:



Secretary to the Board of Directors

CERTIFICATION

I, Julie B. Saba, Secretary to the Board of Directors of Jurupa Community Services District, certify that the foregoing ordinance was introduced at a regular meeting of the Board of Directors on the 11th day of March 2019, and was adopted by the Board of Directors at a regular meeting held on the 25th day of March 2019, by the following vote of the Directors:

AYES: Jane F. Anderson, Richard 'Dickie' Simmons, Betty Folsom, Kenneth J. McLaughlin, Betty A. Anderson

NOES: None


ABSENT: None

ABSTAINED: None


IN WITNESS WHEREOF, I have hereunto set my hand and affixed the official seal of Jurupa Community Services District this 25th day of March 2019.


Secretary to the Board of Directors

(SEAL)



STANDARD DRAWING S-5

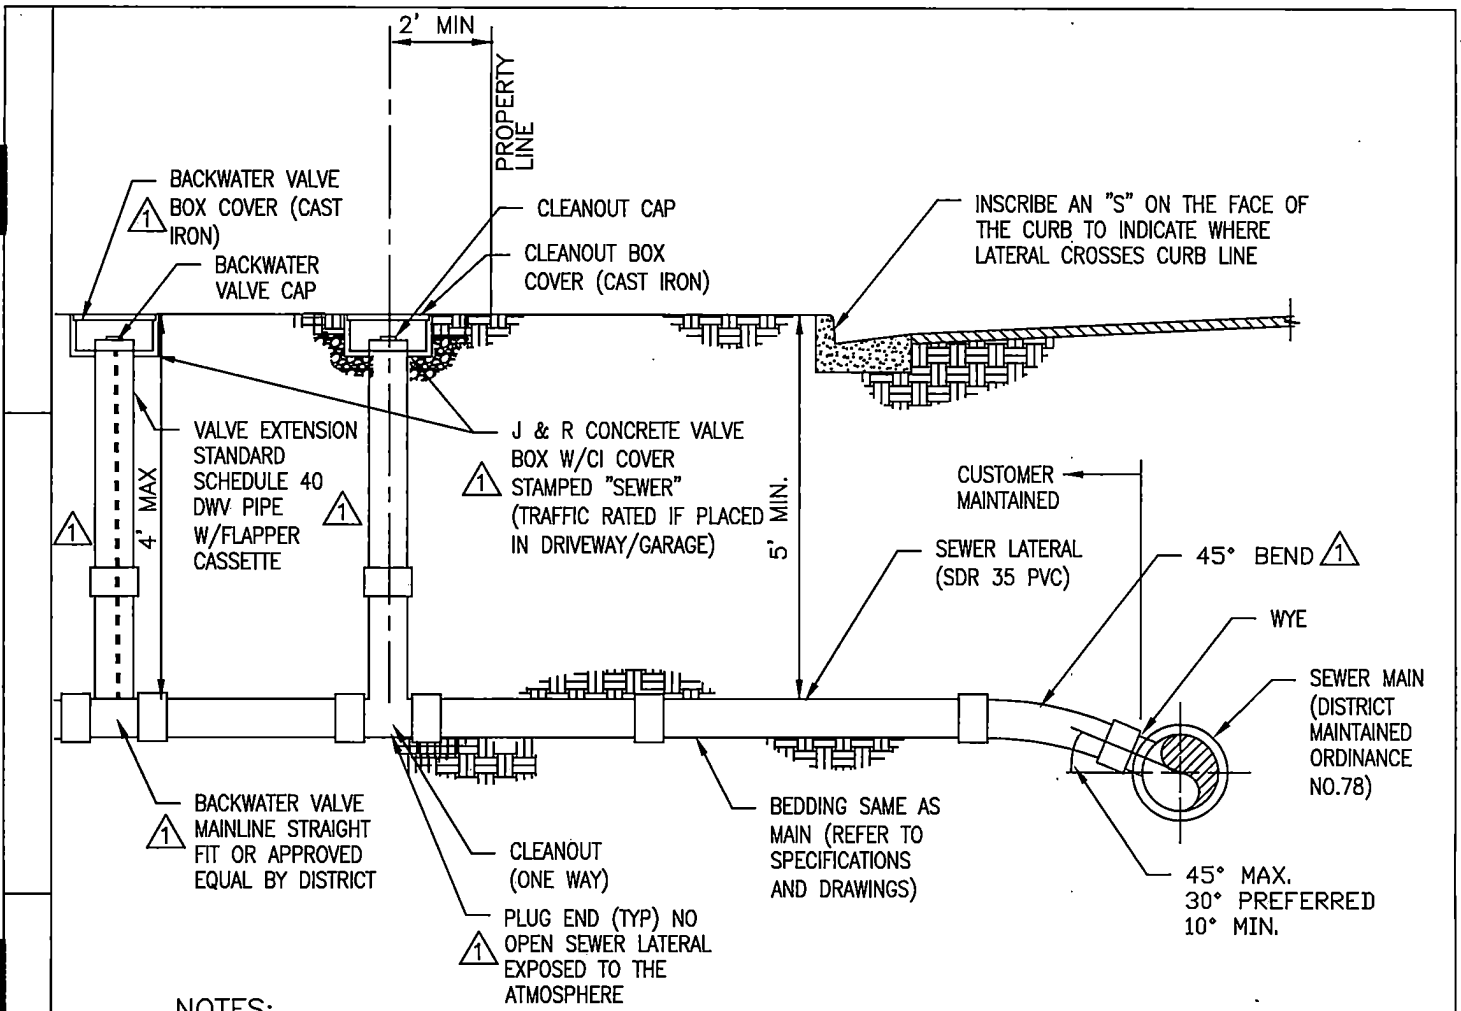

NOTES:

1. 4" PIPE FOR SINGLE DWELLINGS, 6" MIN. FOR ALL OTHER LATERALS.
2. All 8" LATERALS WILL REQUIRE MANHOLE CONNECTION.
3. LATERAL LOCATIONS SHALL BE MEASURED AT RIGHT ANGLES TO STREET CENTERLINE FROM THE CENTERLINE OF THE NEAREST DOWNSTREAM MANHOLE COVER.
4. WHENEVER DEPTH OF COVER OVER LATERAL IS LESS THAN 4'-0", SPECIAL BEDDING OR CONCRETE CRADLE SHALL BE USED.
5. CONTRACTOR SHALL REFERENCE EACH LATERAL IN THE FIELD WITH A SURFACE MARKER. MARKER SHALL BE METAL STAKE PLACED AT TIME OF BACKFILLING. MARKER SHALL BE VERTICAL AND CUT OFF 6" ABOVE GRADE.
6. SEWER LATERALS FOR ALL LOTS WHICH HAVE PAD ELEVATIONS AT OR BELOW STREET GRADE SHALL BE CONSTRUCTED AT 2% SLOPE. IN NO CASE SHALL ANY SEWER LATERAL BE CONSTRUCTED AT LESS THAN 2% SLOPE UNLESS OTHERWISE SHOWN ON DISTRICT APPROVED PLANS.
7. SEWER PLUGS TO BE INSTALLED INTO LATERAL STUBOUTS AND INFLATED WHILE MAKING HOUSE CONNECTIONS TO THE SEWER MAIN. CONNECTIONS TO BE MADE WITH DISTRICT INSPECTOR PRESENT.
8. A MANHOLE PER DISTRICT STANDARD DRAWING NO. S-7 SHALL BE PROVIDED AT THE STREET RIGHT-OF-WAY LINE FOR ALL LATERALS 6" IN DIAMETER AND LARGER UNLESS A WASTEWATER FLOW MONITORING STATION IS PROVIDED OR UNLESS OTHERWISE APPROVED IN WRITING BY THE DISTRICT.
9. A BACKWATER VALVE SHALL BE REMOVABLE TYPE IV WITH INSTRUCTIONS FOR INSTALLATION ON THE REMOVABLE TEE HANDLE.
10. BACKWATER VALVE TO BE INSTALLED AT SHALLOW DEPTH OF THE SEWER LATERAL CLOSE TO THE BUILDING PAD TO PROTECT ALL SEWER FIXTURES DRAINING TO SEWER MAIN.
11. "BACKWATER VALVE DOWNSTREAM" SHALL BE PERMANENTLY MARKED ON THE UPSTREAM CLEANOUTS FROM THE BACKWATER VALVE.

SW
02/07/19

JURUPA COMMUNITY SERVICES DISTRICT

SCALE: NONE

DATE:

TYPICAL SEWER LATERAL

DRAWING NO.

S-5

APPROVED BY
Walter G. ...
R.C.E. 26978

11201 HARREL STREET
JURUPA VALLEY, CA 91752

Attachment E3-L: JCSD Resolution 2399
– Brine Line Enforcement Response Plan

RESOLUTION NO. 2399

RESOLUTION OF THE BOARD OF DIRECTORS OF JURUPA COMMUNITY SERVICES DISTRICT ADOPTING AND ESTABLISHING AN ENFORCEMENT RESPONSE PLAN FOR RESPONSE TO VIOLATIONS OF PRETREATMENT, WASTE DISCHARGE, AND SEWER USE REGULATIONS

WHEREAS, federal and state law and associated regulations require operators of wastewater treatment systems, including the Santa Ana Water Project Authority ("SAWPA"), to maintain a pretreatment program to protect the wastewater treatment system against harmful wastewater discharges and spills; and

WHEREAS, the Jurupa Community Services District ("District") contracts with multiple agencies, including SAWPA, for the treatment and disposal of wastewater. The District is a contract agency to SAWPA for implementation of the Inland Empire Brine Line Pretreatment Program within the District's boundaries. The Inland Empire Brine Line ("Brine Line") is owned by SAWPA and conveys brine and industrial wastewater to Orange County Sanitation District ("OCSD") for treatment and disposal. OCSD delegated pretreatment responsibility to SAWPA for implementation of the Brine Line Pretreatment Program within SAWPA's service area. SAWPA and the District entered into the Multijurisdictional Pretreatment Agreement ("MJPA") for the implementation of the Brine Line Pretreatment Program in the District's Service Area; and

WHEREAS, the SAWPA Commissioners and the corresponding contract agencies like the District are committed to effectively enforcing the federal regulations found in 40 CFR part 403 Pretreatment Regulations and related agreements with OCSD by: establishing and adopting an ordinance which regulates the use and quality of discharges permitted to the Inland Empire Brine Line; administering a permitting program to regulate industrial wastewater discharges from Industrial Users ("IU"); monitoring and tracking compliance through inspection of IU facilities and sampling industrial wastewater discharges; evaluating and screening the results of inspection and sampling to identify pretreatment program violations; consistently responding to pretreatment program violations to ensure long-term compliance; and requiring IUs, as necessary, to treat their industrial waste and/or implement Best Management Practices prior to discharge in order to meet the established limitations; and

WHEREAS, on or about January 13, 2014, the District's Board of Directors will adopt Ordinance No. 380 ("District Ordinance") based upon an ordinance adopted by SAWPA ("SAWPA Ordinance") in furtherance of these commitments; and

WHEREAS, the District Ordinance and SAWPA Ordinance require the District and SAWPA to respectively use an Enforcement Response Plan that is adopted by resolution to coordinate progressive enforcement actions against users of the

wastewater treatment system and persons in noncompliance with the District Ordinance and/or the SAWPA Ordinance. In furtherance of this requirement and in accordance with the MJPA, the District has developed an Enforcement Response Plan ("ERP"), which is attached hereto as Exhibit "A" and incorporated herein by this reference, for enforcement of the District Ordinance based upon the Enforcement Response Plan adopted by SAWPA for enforcement of the SAWPA Ordinance on October 15, 2013; and

WHEREAS, the ERP, as attached hereto, is intended to implement the enforcement responses set forth in the District Ordinance and is intended to match the requirements of SAWPA's Enforcement Response Plan for the implementation of the Inland Empire Brine Line Pretreatment Program within the District's boundaries, with modifications that are appropriate for the District's program structure and terminology. Where possible, the original language of the SAWPA Enforcement Response Plan has been preserved in the ERP; and

WHEREAS, the District intends by this Resolution to adopt the ERP in accordance with the foregoing and with federal and state requirements, including 40 CFR 403.8(f)(5).

NOW, THEREFORE, BE IT RESOLVED, DETERMINED AND ORDERED BY THE BOARD OF DIRECTORS OF JURUPA COMMUNITY SERVICES DISTRICT AS FOLLOWS:

Section 1. Incorporation of Recitals. The Recitals set forth above are true and correct and are incorporated into this Resolution by reference as though fully set forth herein.

Section 2. Adoption of Enforcement Response Plan. The ERP as shown in Exhibit A, attached hereto and incorporated herein by reference, is hereby adopted in its entirety.

Section 3. Amendment. The Board of Directors may amend the ERP established by this Resolution from time to time.

Section 4. Severability. If any portion of this Resolution is declared invalid, illegal, or otherwise unenforceable by a court of competent jurisdiction, the remaining provisions shall continue in full force and effect.

Section 5. Certification and Effective Date. The Board Secretary shall certify the adoption of this Resolution. This Resolution shall become effective immediately upon its adoption.

ADOPTED this 9th day of December 2013.



President of the Board of Directors

ATTEST:



Secretary of the Board of Directors

CERTIFICATION

I, Julie B. Saba, Secretary of the Board of Directors of Jurupa Community Services District, certify that the foregoing resolution was adopted by the Board of Directors at a regular meeting held on the 9th day of December 2013, by the following vote of the Directors:

AYES: Robert Craig, Betty A. Anderson, Jane F. Anderson, Chad Blais, Kenneth J. McLaughlin

NOES: None

ABSENT: None

ABSTAINED: None

IN WITNESS WHEREOF, I have hereunto set my hand and affixed the official seal of Jurupa Community Services District this 9th day of December 2013.


Secretary of the Board of Directors

(SEAL)

EXHIBIT A

Enforcement Response Plan



**Jurupa Community Services
District
Pretreatment Program
Brine Line
Enforcement Response Plan**

December 9, 2013

Table of Contents

1.0 Introduction.....	3
A. Implementation of Program.....	3
B. Control Authority.....	3
C. ERP Objectives.....	4
D. Member and Contract Agencies.....	5
2.0 ERP- Overview.....	7
A. Pretreatment Program Elements.....	7
B. Enforcement Response Plan - Determination of Response.....	7
C. Carrying out of Enforcement.....	8
D. Enforcement Closure.....	8
E. Significant Non-Compliance.....	8
3.0 ERP Screening step.....	9
A. Implementation of Enforcement Actions.....	9
4.0 Violation Types.....	11
A. Administrative Violations.....	11
1. Minor Administrative Violations.....	11
2. Major Administrative Violations.....	11
B. Violations of Discharge Limitations.....	12
1. Minor Violations.....	12
2. Major Violations.....	12
C. Unclassified Violations.....	12
D. Separate Violations.....	12
5.0 Basis for ERP & Guide.....	14
A. Violation Categories.....	14
1. Unauthorized Discharges.....	14
2. Exceedance of Discharge Limits.....	14
3. Violation of Self-Monitoring Requirements.....	15
4. Violation of Permit Reporting Requirements.....	15
5. Violation of Administrative Mandates.....	15
6. Violation of Ordinance and Permit Conditions.....	16
B. Range of Enforcement Responses.....	16
1. Informal Notice.....	16
2. Written Warning.....	16
3. Correction Notice.....	16
4. Monitoring/Production Information Order (MPIO).....	17
5. Notice of Violation (NOV).....	17
6. Violation Meeting.....	17
7. Consent Order.....	17
8. Compliance Order.....	17
9. Civil Penalty Order.....	18
10. Cease and Desist Order.....	18
11. Show Cause Hearing.....	18
12. Wastewater Discharge Permit Revocation.....	18
13. Emergency Suspension Order.....	19
14. Termination of Service.....	19
15. Annual Publication for Significant Noncompliance.....	19

16.	Administrative Complaint.....	19
17.	Civil Liability.....	20
18.	Criminal Penalties.....	20
19.	Supplemental Enforcement Actions	20
C.	Criteria for Determining Appropriate Enforcement Actions.....	20
1.	Magnitude of the Violation.....	21
2.	Duration and/or Frequency of the Violation.....	21
3.	The Effect of the Violation on Public Health or the Environment	21
4.	The Effect of the Violation on the JCSD Sewer System, Brine Line, OCSD's POTW, or Agency Personnel	21
5.	Compliance History of the IU.....	21
6.	Good Faith Efforts of the IU to Eliminate Noncompliance.....	21
D.	Personnel Responsibilities	22
E.	Enforcement Response Timeliness.....	22

List of Figures

Figure 1.1 – Pretreatment Program Regulatory Structure.....	5
Figure 3.1 – Violations Type Overview.....	8
Figure 2 – ERP Overview.....	34

List of Tables

Table 1 – ERP and Guide Implementation Timeframes.....	21
Table 2 – Unauthorized Discharge Violations.....	22
Table 3 – Violation of Discharge Limits.....	24
Table 4 – Violation of Self-Monitoring Requirements.....	26
Table 5 – Violation of Permit Reporting Requirements.....	28
Table 6 – Violation of Administrative Mandates.....	29
Table 7 – Violations of Ordinance or Special Permit Conditions.....	31
Table 8 – Personnel Responsibilities.....	35

Attachment E3-M: JCSD Standards Manual



Jurupa
COMMUNITY SERVICES DISTRICT



STANDARDS MANUAL

For

WATER AND SEWER FACILITIES

JUNE, 2011

A L B E R T A .

WEBB

A S S O C I A T E S

**JURUPA COMMUNITY SERVICES DISTRICT
STANDARDS MANUAL**

TABLE OF CONTENTS

SECTION I : INTRODUCTION

SECTION II : GENERAL REQUIREMENTS

SECTION III : WATER SYSTEM DESIGN CRITERIA

SECTION IV : SEWER SYSTEM DESIGN CRITERIA

SECTION V : BASIC SPECIFICATIONS

SECTION VI : STANDARD DRAWINGS

SECTION VII : APPENDICES

Each section is separated by dividers with a detailed table of contents under each section. Lettered divider tabs are provided under Sections V, VI & VII for sub-sections as indicated in Table of Contents for each of these sections.

SECTION IV
SEWER SYSTEM DESIGN CRITERIA

TABLE OF CONTENTS

SECTION IV - SEWER SYSTEM DESIGN CRITERIA

A.	GENERAL.....	IV-1
B.	LOCATIONS OF MAINS	IV-1
C.	FLOW RATE COMPUTATIONS	IV-1
D.	PIPE SIZING	IV-2
E.	MANHOLES	IV-3
F.	PIPE VELOCITIES	IV-4
G.	SLOPES	IV-4
H.	BEDDING.....	IV-5
I.	BACKWATER VALVES	IV-6
J.	SEWAGE INJECTORS.....	IV-6
K.	LATERAL CONNECTIONS TO MAIN	IV-6
L.	INDUSTRIAL WASTE PROVISIONS	IV-7

SECTION V
BASIC SPECIFICATIONS

TABLE OF CONTENTS

SECTION V - BASIC SPECIFICATIONS

A.	GENERAL SPECIFICATIONS	A-1
B.	WATER PIPELINE MATERIALS SPECIFICATIONS	B-1
C.	WATER PIPELINE CONSTRUCTION SPECIFICATIONS	C-1
D.	SEWER PIPELINE MATERIALS SPECIFICATIONS	D-1
E.	SEWER PIPELINE CONSTRUCTION SPECIFICATIONS	E-1

BASIC SPECIFICATIONS
SECTION A

GENERAL SPECIFICATIONS

BASIC SPECIFICATION

SECTION A

GENERAL SPECIFICATIONS

TABLE OF CONTENTS

	<u>Page</u>
1. Reference Specifications.....	A-1
2. Contractor's Schedule Of Work	A-1
3. Inspection	A-2
4. Defective Workmanship And Material	A-3
5. Sanitation	A-3
6. First Aid And Protective Facilities	A-4
7. Contractor To Provide Facilities For Employees.....	A-4
8. Power	A-4
9. Cleanup	A-4
10. Utilities And Easements	A-5
11. Relationship With Other Governmental Agencies	A-5
12. Exposure Of Utilities In Advance Of Work	A-6
13. Advance Notification Of Agencies.....	A-6
14. Crossing, Protection And/Or Relocation Of Utilities	A-7
A. General.....	A-7
B. Utilities Shown On Plans.....	A-7
C. Special Water/Sewer Crossings	A-8
D. Relocation Of Utilities By The Contractor For His Own Convenience	A-8
E. Service Connections	A-9
F. Utility Conflicts With Proposed Improvements	A-9
G. Unknown Utilities Disclosed During Contract Work.....	A-9
H. Responsibility Of The Contractor.....	A-11
15. Protection Of Facilities Other Than Utilities.....	A-11

BASIC SPECIFICATION
SECTION A
GENERAL SPECIFICATIONS
TABLE OF CONTENTS
(continued)

16.	Ground Water	A-12
17.	Construction Water	A-12
18.	Water Supply For Compaction And Dust Control.....	A-12
19.	Traffic Control	A-12
20.	Access To Adjacent Properties	A-13
21.	Staking Of Line And Grade	A-13
22.	Protection Of Survey Monuments	A-14
23.	Record Drawings	A-14
24.	Reseeding.....	A-14
25.	Erosion Control.....	A-15
	A. General.....	A-15
	B. Preparation	A-15
	C. Material	A-15
	D. Protection For Steep Slopes.....	A-16
26.	Contractor's Submittals.....	A-16
27.	Responsibility For Material Furnished By The District.....	A-17
28.	Errors Or Discrepancies Noted By Contractor	A-17
29.	Handling And Storage Of Materials	A-18
30.	Geotechnical Services.....	A-18
31.	Earthwork.....	A-18
	A. General.....	A-18
	B. Clearing And Grubbing	A-20
	C. Grading Along Pipeline	A-20
	D. Trench Excavation	A-20
	E. Trench And Excavation Shoring.....	A-23
	F. Pipe Bedding.....	A-23
	G. Special Crushed Rock Bedding	A-25
	H. Trench Backfill And Compaction Requirements.....	A-26

BASIC SPECIFICATION
SECTION A
GENERAL SPECIFICATIONS
TABLE OF CONTENTS
(continued)

I. Structure Excavation And Backfill A-31

J. Control Of Water A-31

K. Payment A-32

BASIC SPECIFICATIONS
SECTION D

SEWER PIPELINE MATERIALS SPECIFICATIONS

BASIC SPECIFICATIONS
SECTION D
SEWER PIPELINE MATERIALS SPECIFICATIONS

TABLE OF CONTENTS

	<u>Page</u>
1. General.....	D-1
2. Gravity Mains	D-1
A. Vitrified Clay Pipe (VCP).....	D-1
B. Polyvinyl Chlorine (PVC) Plastic Pipe (4" to 12" Dia.).....	D-2
C. Acrylonitrile-Butadiene-Styrene (ABS) (4" & 6" Dia.).....	D-2
D. Ductile Iron Pipe (DIP).....	D-2
3. Forcemains.....	D-3
A. Polyvinyl Chlorine (PVC) Plastic Pipe (4" to 12" Dia.).....	D-3
B. Ductile Iron Pipe (DIP).....	D-3

BASIC SPECIFICATIONS
SECTION E

SEWER PIPELINE CONSTRUCTION SPECIFICATIONS

BASIC SPECIFICATIONS

SECTION E

SEWER PIPELINE CONSTRUCTION SPECIFICATIONS

TABLE OF CONTENTS

	<u>Page</u>
1. Sewer Pipe Installation	E-1
A. General.....	E-1
B. Installation Of Pipelines.....	E-1
C. Sewer Constructed On Radius	E-2
D. Cleaning.....	E-2
E. Plastic Sewer Systems	E-2
F. Measurement And Payment.....	E-4
G. Payments To Contractor For Completed Work	E-4
2. Manholes.....	E-5
A. General.....	E-5
B. Precast Concrete Sections.....	E-5
C. Manhole Bases.....	E-6
D. Manhole Frames And Covers	E-6
E. Standard Manholes	E-7
F. Joint Wrap In Groundwater Conditions.....	E-7
G. Testing Of Manholes	E-8
3. Sewer Laterals.....	E-8
A. General.....	E-8
B. Materials	E-9
C. Tees And Wyes.....	E-9
D. Construction.....	E-9
E. Payment	E-9
4. Tests For Leakage In Sewer.....	E-10
A. General.....	E-10

B.	Air Testing	E-10
C.	Water Infiltration Test	E-11
D.	Force Main Pressure Test	E-12
5.	Concrete Work.....	E-13
A.	General.....	E-13
B.	Portland Cement Concrete Classification	E-13
C.	Class "B" Concrete Encasement	E-14
D.	Reinforced Concrete Encasement.....	E-14
6.	Pavement Removal And Replacement	E-14
B.	Pavement Cutting.....	E-15
C.	Asphalt Concrete Cap	E-15
7.	Connections To Existing Manholes.....	E-16
8.	Temporary Handling Of Sewage	E-16
9.	Steel Casing	E-17
10.	Jacked Steel Casing	E-18
11.	Video Inspection	E-19
	Video Inspection Company Requirements	E-21
12.	Vacuum Testing Of Manholes.....	E-22
A.	General.....	E-22
B.	Pre Versus Post Backfilling Test Criteria	E-22
C.	Reference Standard	E-22
D.	Manhole Preparation.....	E-22
E.	Basic Field Testing Procedure	E-23
F.	Minimum Test Times – Standard Manholes	E-23
G.	Inspection And Re-Testing	E-24
H.	Approved Vacuum Testing Companies.....	E-25


SECTION VI
STANDARD DRAWINGS

B. SEWER SYSTEM STANDARD DRAWINGS

S-1	General Bedding Details
S-2	General Bedding Details Flexible Gravity Pipe
S-3	Special Crushed Rock Bedding
S-4	Typical Concrete Encasement Detail
S-5	Typical Sewer Lateral
S-6	Deep Lateral
S-7	Precast Concrete Manhole
S-8	DELETED
S-9	DELETED
S-10	DELETED
S-11	Wastewater Flow Monitoring Station
S-12	Industrial Waste Clarifier Three Compartment
S-13	DELETED
S-14	Building Sewer Sampler Detail
S-15	DELETED
S-16	Sewer Protection Detail
S-17	Remodeling Details For Sewer Laterals
S-18	Sewer Lateral Connection To Existing Main
S-19	Grease Interceptor 750 Gal. To 1500 Gal.
S-20	Grease Interceptor 2000 gal. To 3000 Gal.
S-21	72" and 84" Dia. Precast Concrete Manhole (PVC lined)
S-22	DELETED
S-23	Manhole Cover Details
S-24	Onsite Sewer Location

Attachment E3-N: Diagram illustrating
lateral maintenance responsibilities

**WHAT DO YOU DO IF YOUR SEWER STOPS UP?
County Policy Regarding Sewer Maintenance**

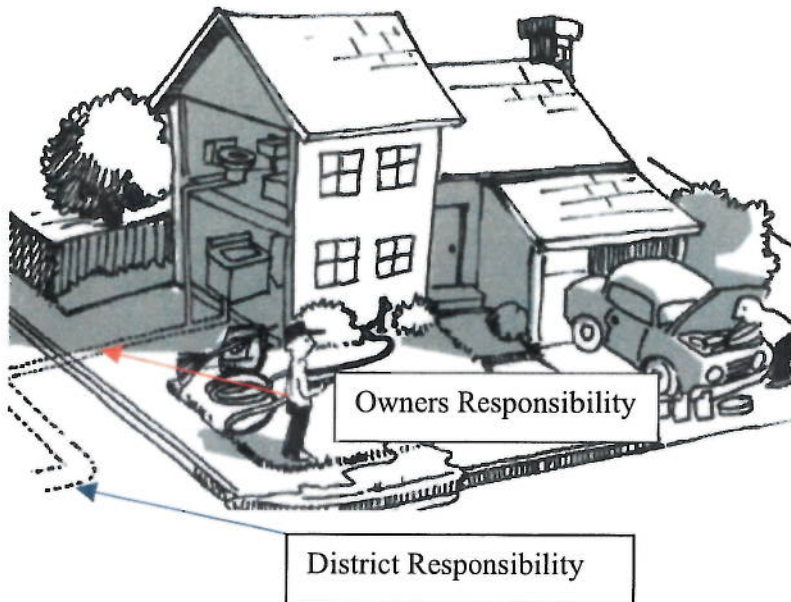

- 1** Call the District First! We'll check the main sewer.

When sewer problems are experienced, the resident should first contact the District. We will check the main sewer and, if there is a cleanout existing at ground level, we will also inspect that to determine if the stoppage is in the service sewer or the building site.

- 2** Property Owner's Responsibility! If the main is OK, we recommend that you then call a plumbing or sewer contractor.

The owner of the property is responsible for keeping the sewer clear between the building and the main. If there is no cleanout at ground level, the owner is also responsible for clearing the service sewer to the main sewer. Locating the building sewer, the owner's responsibility, although we will attempt to assist with available records and information. We suggest the owner employ a plumbing or sewer contractor to clear any stoppages in the building or service sewer. The contractor should contact us before closing the excavation.

NOTE: Although there is no extra charge for our services (the work financed by district sewer bills). We will not assume the cost of your contractor's call, regardless of the location of the stoppage!